

# FORD ANALYTICAL LABORATORIES

CHEMICAL AND BACTERIOLOGICAL ANALYSIS

DATE: 04/18/94 CERTIFICATE OF ANALYSIS

\*FREEZE CREEK WATER  
% THE BOYER CO.  
127 SO. 500 E. #127  
SLC, UT 84102


94-021070

(Boyer Well Nr. 2)

15143-02

SAMPLE: WATER SAMPLE FROM WELL #2 COLLECTED 2-25-94, 8:00 A.M. BY FD  
RECEIVED 2-25-94 FOR PHASE 2/5 ANALYSIS.

	Results	Method Detection Limit
Aluminum Al mg/l EPA 200.7	.06	.05
Antimony Sb mg/l EPA 200.9	ND	.005
Arsenic As mg/l EPA 200.9	ND	.005
Barium Ba mg/l EPA 200.7	.054	.010
Beryllium Be mg/l EPA 200.9	ND	.001
Cadmium Cd mg/l EPA 200.9	ND	.001
Chromium Cr mg/l EPA 200.9	ND	.002
Copper Cu mg/l EPA 200.7	.39	.01
Cyanide CN tot.mg/l EPA 335.2	ND	.050
Fluoride mg/l EPA 340.2	.35	.10
Iron Fe mg/l EPA 200.7	.274	.010
Lead Pb mg/l EPA 200.9	.036	.005
Manganese Mn mg/l EPA 200.7	ND	.010
Mercury Hg mg/l EPA 245.1	ND	.0002
Nickel Ni mg/l EPA 200.7	ND	.003
Nitrate NO3-N mg/l EPA 300	.3	.01

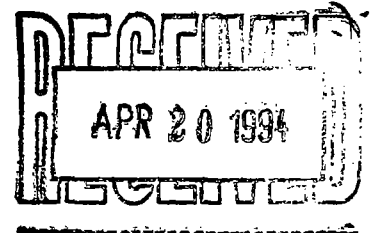

All reports are submitted as the confidential property of clients. Authorization for publication of our reports, conclusions, or extracts from or regarding them, is reserved pending our written approval as a mutual protection to clients, the public and ourselves.