

# FORD ANALYTICAL LABORATORIES

CHEMICAL AND BACTERIOLOGICAL ANALYSIS

DATE: 04/18/94 CERTIFICATE OF ANALYSIS


\*FREEZE CREEK WATER  
% THE BOYER CO.  
127 SO. 500 E. #127  
SLC, UT 84102

94-021070

15143-02

SAMPLE: WATER SAMPLE FROM WELL #2 COLLECTED 2-25-94, 8:00 A.M. BY FD  
RECEIVED 2-25-94 FOR PHASE 2/5 ANALYSIS.

|                               | Results | Method Detection Limit |
|-------------------------------|---------|------------------------|
| Aluminum Al mg/l EPA 200.7    | .06     | .05                    |
| Antimony Sb mg/l EPA 200.9    | ND      | .005                   |
| Arsenic As mg/l EPA 200.9     | ND      | .005                   |
| Barium Ba mg/l EPA 200.7      | .054    | .010                   |
| Beryllium Be mg/l EPA 200.9   | ND      | .001                   |
| Cadmium Cd mg/l EPA 200.9     | ND      | .001                   |
| Chromium Cr mg/l EPA 200.9    | ND      | .002                   |
| Copper Cu mg/l EPA 200.7      | .39     | .01                    |
| Cyanide CN tot.mg/l EPA 335.2 | ND      | .050                   |
| Fluoride mg/l EPA 340.2       | .35     | .10                    |
| Iron Fe mg/l EPA 200.7        | .274    | .010                   |
| Lead Pb mg/l EPA 200.9        | .036    | .005                   |
| Manganese Mn mg/l EPA 200.7   | ND      | .010                   |
| Mercury Hg mg/l EPA 245.1     | ND      | .0002                  |
| Nickel Ni mg/l EPA 200.7      | ND      | .003                   |
| Nitrate NO3-N mg/l EPA 300    | .3      | .01                    |

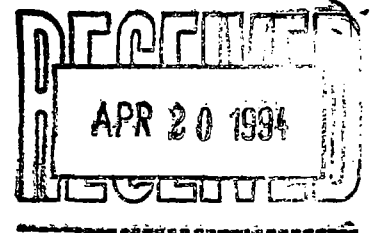

All reports are submitted as the confidential property of clients. Authorization for publication of our reports, conclusions, or extracts from or regarding them, is reserved pending our written approval as a mutual protection to clients, the public and ourselves.